

Per 165474034


PERMIT FOR CONSTRUCTION OF SUBSURFACE SEWAGE DISPOSAL SYSTEM

sued to: <u>Gilman and Devoe</u> Owner, Developer, Contractor, Installer, Etc.	REGION <u>02</u>	COUNTY <u>05</u>	ID-NUMBER	DATE <u>09/15/84</u>
	STAFF <u>007</u>	INSTALLATION: <input checked="" type="checkbox"/> 1. New Installation <input type="checkbox"/> 2. Repair to Existing System		
To be constructed by <u>Orati Keck</u> (Installer)	Type of System: <input checked="" type="checkbox"/> 1. Standard <input type="checkbox"/> 3. Chapter 301 <input type="checkbox"/> 5. Other <input type="checkbox"/> 2. Alternating <input type="checkbox"/> 4. Chapter 212			
Construction of a subsurface sewage disposal system is hereby authorized at: <u>Bay View South Sid A0763</u> (No. and street: Subdivision name and lot no.)	For: <input type="checkbox"/> 1. Residential: No. B/R <u>3</u> <input type="checkbox"/> 2. Commercial/Industrial; Gal/Day _____			
Such a system shall consist of a septic tank of <u>1000</u> gals. with <u>341</u> linear feet in <u>4</u> trenches. <u>36</u> inches wide, and <u>36-48</u> deep or _____	Evaluation based Upon: <input checked="" type="checkbox"/> 1. Soil Typing by Soil Scientist <input type="checkbox"/> 2. Soil Percolation Tests <input type="checkbox"/> 3. Other Permeability Rate <u>60 min/inch</u>			

The recipient of this permit agrees to construct or have constructed the system in accordance with the rules and regulations under the authority of TCA 53-2054. The recipient must notify the local health authority when the system is ready for inspection. If any part of system is covered before being inspected and approved, it shall be uncovered by the recipient of the permit at the direction of the local health authority.

Date 09/11/84

Issued at Seymour Tennessee in the County of Blount
By Blount Co. Health Dept., Howard J. Coburn Date 09/11/84
(Local Health Authority)

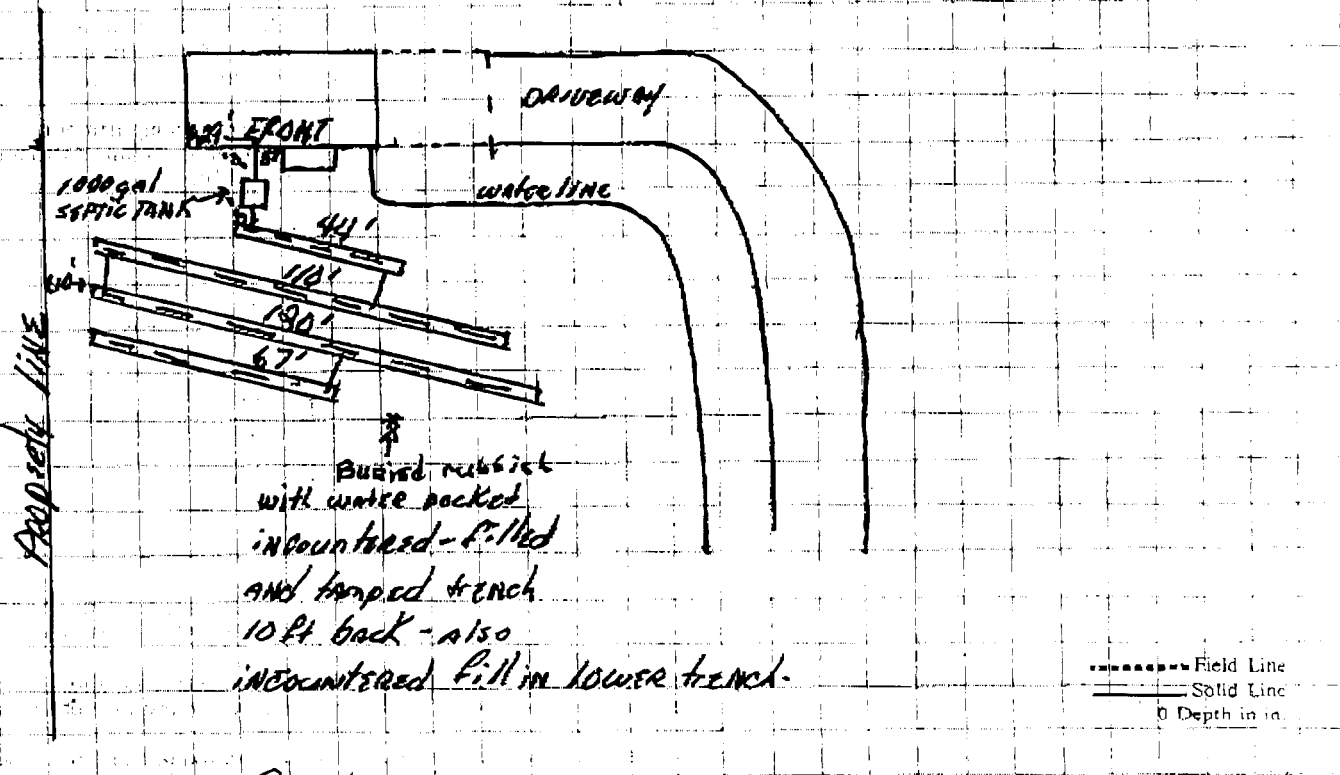

Inspected By Howard J. Coburn Local Health Authority
Date 10/05/84

Construction Approval: 1. Yes 2. No

No. of Visits: 2

0	3	3
---	---	---

Time